

Experion LX Server Specification



LX03-200-120

Release 120

August 2015, Version 1.1

Revision History

Revision	Date	Description
1.0	February 2015	Release Publication
1.1	August 2015	Update on DSA interoperability

Table of Contents

1.	Product Introduction.....	4
1.1.	Experion LX	4
1.2.	Architecture Overview.....	4
1.3.	Experion LX Server Overview.....	4
1.4.	Database Sizing.....	5
1.5.	Enterprise Model Sizing	8
1.6.	History Sizing.....	9
1.7.	Server Data Acquisition Performance	12
1.8.	Notification Performance.....	13
1.9.	Supervisory Control and Data Acquisition (SCADA)	14
1.10.	Server Scripting	16
2.	Option Specifications	17
2.1.	Server Redundancy	17
2.2.	Distributed Systems Architecture (DSA)	17
2.3.	CDA Integration with Safety Manager.....	18
2.4.	OPC.....	20
2.5.	Interfaces	27
2.6.	Microsoft Excel Data Exchange	27
2.7.	Application Development Toolkit.....	27
2.8.	Application Enablers	28
3.	Hardware and Software Requirements	31
3.1.	Experion LX Server Computer Requirements	31
4.	Model Numbers	34
4.1.	Server Database.....	34
4.2.	Server Redundancy	34
4.3.	Media Kits, Stations and CALs	34
4.4.	Distributed System Architecture.....	35
4.5.	OPC.....	35
4.6.	Experion LX Software Options	35
4.7.	Engineering Tools	35
4.8.	Batch Manager	36
4.9.	Field Device Usage.....	36
4.10.	Qualification and Version Control System.....	36
4.11.	Electronic Signature.....	36
5.	Glossary.....	37

1. Product Introduction

1.1. Experion LX

As a member of Honeywell's Experion family, Experion LX is specifically designed to meet the customer needs in mid-tier markets (Chemicals, Industrial Power, F&B, Bio-fuels, ...), through integrating state-of-the-art technology from the award-winning Experion Process Knowledge System (PKS) with innovative design of Series 8 I/O modules and cabinets, validated wider range of COTS options, easier engineering and maintenance capabilities, and integrator-friendly programs and tools. Experion LX is the perfect platform for process, asset and business management, and enables customers to increase their profitability and productivity and accessibility to local support without sacrificing quality and reliability in an increasingly competitive environment.

1.2. Architecture Overview

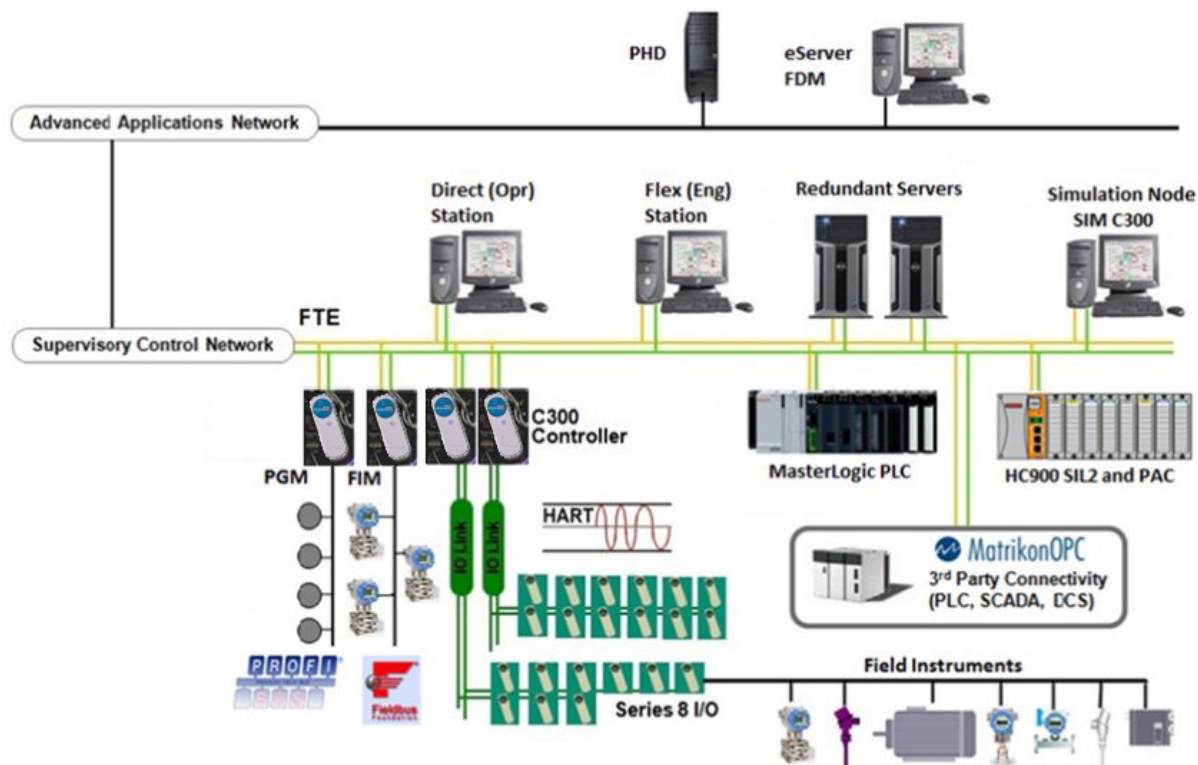


Figure 1 - Sample Experion LX architecture

The Experion LX platform comprises many different integrated hardware and software solutions depending upon the needs of the application. This pictured architecture is a representation of many of the possible nodes that can be used in the Experion LX architecture. Note that the architecture is highly scalable and not all nodes are necessary or required.

1.3. Experion LX Server Overview

The Experion LX Server or redundant LX Server combination functions as a system-wide historian and global database. The Experion LX Server also supports communication to SCADA point sources, DSA point sources, OPC clients and LX Servers and holds the system event journal, system configuration files, custom applications and server scripts. The LX Server is the source for data, alarms, events, etc. for the client-connected applications. One or more Experion Servers are required for an Experion LX system.

1.4. Database Sizing

1.4.1. System Capacity

Functional Area	Capacity Description	R120 Entry level system	R120 High Capacity	Description
System Size	Max Server Clusters per System	1	1	The maximum number of Experion LX Servers that can be defined in one system supported by the System Status Display, and connected via DSA
DSA	Max DSA connections per Server	5	5	Maximum number of other Servers that can be connected via DSA, local to this system and/or to remote system Servers
	DSA Data Publish	1,500 PPS	1,500 PPS	Maximum number of parameters/sec to all remote servers
Server Point Counts	Max Total Server Points	13,000 (4K SCADA+ 8K Process +1K Equipment)	167,000(50K SCADA + 10 K Process + 2k Equipment + 5 K Non-CEE + 100000)	
	Max SCADA Points	4,000	50,000	Total number of SCADA Points configured per Experion LX Server Cluster <i>Note: Container Points count against this limit</i>
	Max Process Points	8,000	10,000	Any device that uses the Control Data Access (CDA) interface consumes process points (C300 Controllers).
	Max DSA Points	0	100,000	Total Points collected from other Experion LX Servers via DSA
	Max CDA Points	5,000	15,000	Total CDA/CEE "Process" points configured in a single ERDB
	Max Non – CEE Points	-	5,000	Total Non-CEE Points Published from SM to C300 Controller
	PSA (Point Server) Points		No overall limit	The PSA point count is an aggregation of points from point server interfaces such as SPS/Adv OPC /BMA/TPS/etc. Each interface may have its own limits but the overall PSA count will count against the total point count limit for a server
	Equipment points	1,000	2,000	Other points and hardware items built as part of the equipment still contribute to their own relevant capacity constraints.
	Equipment points system wide	5,000	10,000	If a server is subscribing to other servers via DSA, the total of all remote equipment and local equipment points cannot exceed this number.

	EFM Meters	2,000	2,000	Used to collect and export custody transfer data. An EFM meter uses one SCADA point license.
	SCADA Point Algorithms	50,000	50,000	Algorithm blocks can be linked to SCADA points
System Point Counts	Total of all point types per DSA connected system	13,000	167, 000	The maximum number of points in a system (a system consists of multiple servers)
SCADA	RTU/Controller configuration range	50	999	Supported range that RTU's can be assigned to. <i>(Note: Performance of large numbers of RTU's will be based other system, channel, and controller limitations).</i>
SCADA channels	SCADA channels	20	99	
Direct station	Max Direct Stations per Cluster	10	15	
Flex Stations	Max Direct Stations per Cluster	0	10	

1.4.2. Alarm, Event, Alert and Message Lists

Items	Specifications	Comments
Maximum number of active alarms and alerts	4,000	Alarms and alerts occupy the same storage space so there can be a maximum of 4,000 active alarms and alerts in the Alarm and Alert summaries.
Maximum number of active messages	1,000	Number of messages that appear in the Message summary.
Maximum number of SOE messages	32,767	Number of SOE messages that can appear in the SOE summary.
Maximum number of events in online event file	1.2 million	<ul style="list-style-type: none"> All alarms, login actions, operator actions, and configuration changes are logged in the online event file. Up to two events are generated for every alarm, including one event for entering the alarm condition and one for return to normal.

1.4.3. Other Database Sizing Specifications

Items	Specifications	Comments
Printer connections	20	This is the total number of printers that can be configured as either report or alarm devices.
Trend sets	3,000	
Trend pens per set	32	
Trend periods	1, 5, 20 minutes 1, 2, 4, 8, 12 hours 1, 2, 5 days 1, 2, 4 weeks 3, 6 months 1 year	
Operating groups	16,000	
Points per group	8	
Reports	1,000	
Operators	1,000	This is the default limit. The quantity can be increased to 32,000, if required.
Number of recipes	500	
Number of messages	1000	
Number of point control scheduler	1000	

1.5. Enterprise Model Sizing

1.5.1. Assets

Description	Standard Capacity System	High Capacity System	Comments
Assets	1000	1000	The asset model represents the organization of items in the enterprise, for example, process units, individual pieces of equipment or facilities, etc. The relationship or hierarchy between assets and entities forms the asset model. The primary relationship in the asset model is that of asset containment, where one asset contains another.
Assignable assets	500	1000	Assignable assets provide a way to assign assets to an operator's scope of responsibility. An assigned asset includes all asset children of the assigned asset including any points associated with those assets or any alarm groups that have been designated by that asset for scope of responsibility purposes. The number of assignable assets is a subset of the total number of assets.
Nesting depth for asset hierarchies	10	10	
Children per asset	No limit	No limit	

1.5.2. Alarm Groups

Description	Standard Capacity System	High Capacity System	Comments
Alarm groups	500	1000	Alarm Groups present alarm state/status for a disparate group of points and assets that are not represented by a single asset in the asset model.
Children per alarm group	500	500	
Nesting depth for alarm group hierarchies	5	5	

1.6. History Sizing

1.6.1. Collection Rates

Items	Specifications	Comments
Standard history	<ul style="list-style-type: none"> • Predefined collection rates of 1, 2, 5, 10 and 30 minutes • 3 additional user defined collection rates can be defined. 	<ul style="list-style-type: none"> • When you configure a point parameter for standard history collection, Experion LX also collects 4 different standard history averages, based on the standard history snapshot rate that you choose for standard history collection. • The default standard history snapshot rate is 1 minute and the collection rates for averages are 6-minute, 1-hour, 8-hour and 24-hour averages. • The averages are calculated using the 1-minute base interval. That is, 6-minute averages are calculated on six 1-minute values. If you change the 1-minute base interval the averages are still calculated from the base interval. For example, if you change the base interval to 30 seconds, 6-minute averages are calculated on twelve 30-second values.
Fast history	<ul style="list-style-type: none"> • Predefined collection rates of 5, 10, 15, 20 and 30 seconds. • 3 additional user defined collection rates can be defined. 	<ul style="list-style-type: none"> • A maximum of 8 collection rates can be defined choosing from the default intervals on the left • Additional rates can be defined; however they must be in multiples of the base rates. • The 5 second base rate can be configured to 1 second.
Extended history	<ul style="list-style-type: none"> • 1-hour snapshot • 8-hour snapshot • 24-hour snapshot 	<ul style="list-style-type: none"> • When a point is configured for extended history collection, all of these intervals are stored.
Exception history	<ul style="list-style-type: none"> • 5, 10, 15, 30, and 60 seconds • 5, 10, 15, 30, and 60 minutes • 2, 4, 6, 8, 12, and 24 hours 	<ul style="list-style-type: none"> • Whereas standard, fast, and extended history collect and store point parameter values periodically, exception history collects values at the rate configured for that point parameter but only stores them if the value or quality of that point parameter has changed since it was last stored. • Note that exception history only collects and stores string values.
To support daylight savings and time zones, all collected data is historized in Universal Time Coordinated (UTC) time.		

1.6.2. Default History Files Sizes

Items		Specifications		Comments
		Time	Samples	
Standard history	1-minute snapshot	24 hours	1,442	
	6-minute average	7 days	1,682	The averages are calculated using the 1-minute base interval. That is, 6-minute averages are calculated on six 1-minute values.
	1-hour average	7 days	170	The averages are calculated using the 1-minute base interval.
	8-hour average	3 months	281	The averages are calculated using the 1-minute base interval.
	24-hour average	1 year	368	The averages are calculated using the 1-minute base interval.
Fast history	1-second or 5-seconds	2 hours or 12 hours	8,652	
Extended history	1-hour snapshot	7 days	170	
	8-hour snapshot	3 months	281	
	24-hour snapshot	1 year	368	
The number of samples in each history file can theoretically be increased to 100,000 samples. If the size of the history file is increased beyond the default qualified size, care should be taken not to exceed the maximum history file size constraints. (See section 2.3.4). History archiving is available to store the history files for later retrieval. Experion LX history data is seamlessly available for use across every Experion LX Station for trend displays, reports, custom displays, applications, spreadsheets and ODBC compliant databases.				

1.6.3. Maximum Parameters Assigned to History

Items	Specifications	Comments						
Standard history	2,000	This is the default limit that Experion LX is shipped with. It can be changed by a database initialization up to a maximum of 50,000. Double, Float, Integer and Time data can be stored.						
Fast history	500	<div>This is the default limit that Experion LX is shipped with. It can be changed by a database initialization up to the following maximums.</div> <table><thead><tr><th><u>Fast History Collection Rate</u></th><th><u>Maximum Parameters</u></th></tr></thead><tbody><tr><td>1 second</td><td>1000</td></tr><tr><td>5 seconds</td><td>2000</td></tr></tbody></table> <div>Double, Float, Integer and Time data can be stored.</div>	<u>Fast History Collection Rate</u>	<u>Maximum Parameters</u>	1 second	1000	5 seconds	2000
<u>Fast History Collection Rate</u>	<u>Maximum Parameters</u>							
1 second	1000							
5 seconds	2000							
Extended history	2,000	This is the default limit that Experion LX is shipped with. It can be changed by a database initialization up to a maximum of 10,000. Double, Float, Integer and Time data can be stored.						
Exception history	500	<div>This is the default limit that Experion LX is shipped with. It can be changed by a database initialization up to a maximum of 1000.</div> <div>String maximum of 255 characters can be stored. A maximum of 100 exception history parameters can be stored per second.</div>						
The ability to collect history at the configured rate depends upon throughput of underlying process control network, see table 2.4, LX Server Data Access Acquisition Performance.								

1.6.4. Calculating History Space Requirements

Items	Specifications	Comments
Maximum history file size	500 MB	<ul style="list-style-type: none"> Each type of history sample is stored in a separate history file. For example, there are five history files for standard history, one each for: 1-minute snapshot, 6-minute average, and so on. An individual history file should not exceed this size.
Formula for calculating number of samples for a given history file size	<p>If collecting P parameters for a particular history rate with a history file size of S bytes then:</p> <p>Number of samples = $(S/2)/(((P*6)+8)-1)$</p>	<p>Example:</p> <p>Standard history one minute (history 1) file size is 432623072 bytes</p> <p>Number of parameters assigned to standard history is 50000</p> <p>Number of samples = $(432623072)/(((50000*6)+8)-1)=721$ records</p> <p>For efficiency reasons the history file size should be configured to be as close to 500M as possible. The sysbld utility is used to modify the number of parameters assigned and the number of samples collected for each type of history.</p>

1.7. Server Data Acquisition Performance

Items	Standard Capacity System	High capacity system	Comments
Experion LX Controllers			
Maximum CDA throughput from all Controllers – C300 (PPS – Parameters Per Second)	3,700	4,700	
Maximum number of CDA subscribed parameters from all controllers on FTE	8,000	25,000	This is the number of parameters that can be actively subscribed by an Experion LX Server at any one time. The Server adds and removes items from the subscription list based on demand.
DSA			
Maximum pps from each configured DSA subscribing LX Server	0	1,000	This information is duplicated in section 3.2, DSA.
SCADA			
Maximum pps from all configured SCADA devices	Limited by device		
OPC			
Maximum OPC pps from all configured OPC Servers	See section 3.2 , OPC		

1.8. Notification Performance

Items	Specifications	Comments
Alarm and Event Notifications		
Maximum number of events (burst condition) ¹	1,500 events	The Experion LX Server alarm system will handle an event burst of up to 1,500 events, with a minimum time between consecutive bursts. An "event burst" is defined as a group of events greater than 40/sec, received from all connected event servers in a period of less than 3 seconds.
Formula to calculate the time period required between consecutive bursts, to allow for event processing	$\Delta T = BS / (60 - ER)$ Where: ΔT = # of seconds required between bursts BS = Burst Size (number of events in the burst) ER = Event Rate between bursts	Examples: <ul style="list-style-type: none"> 1,500 event burst and no events between bursts: $\Delta T = 1,500 / 60 = 25$ seconds 500 event burst with 30 events/sec between: $\Delta T = 500 / 30 = 17$ seconds
Maximum number of sustained events/second ¹	10,000/hour, with peaks of up to 40/sec	
Maximum number of sustained alarms/second ¹	30/sec	
Maximum duration of events in online events file	12 weeks	
Maximum number of events in online events files	1.2 million	Event archiving can be used to access older events. Approximately 60 MB of hard disk space is required for every 100,000 events archived
Alerts and Notifications		
Maximum number of alerts/second	1	
Maximum burst of alerts	100	These totals are still subject to the overall maximum number of events per second and maximum burst of events limit that the Experion LX Servers can support.
Note 1 – The Experion LX Server includes the option to support OPC alarms and events in addition to native Experion LX notifications. When the Experion LX Server is configured to receive alarms and events from an OPC alarm and event server, the notification limits noted in this table are applicable to the combined set of events received from all connected event sources.		

1.9. Supervisory Control and Data Acquisition (SCADA)

1.9.1. Communication

Items	Specifications	Comments
SCADA Channels	99	Channels typically represent a physical connection to a device, such as a device connected to one port of a terminal server. A channel can support more than one Remote Terminal Unit (RTU).
SCADA RTUs (Controllers)	999	This is the maximum number of RTUs for a given server. It is spread across all channels and includes OPC RTUs to support the OPC client interface as described in section 3.3.1. (This information is duplicated in 3.3.1 "OPC Client Interface (SCADA Client)").

1.9.2. Real Time Database SCADA Point Structures

Point Structure	Standard Parameter		
Common Parameters (Analog, Status and Accumulator)	Point Name	Point Description	Item Name
	Parent Asset	Associated Display	Point & Group Displays
	Scan Enable & Status	PV Last Processed Date/Time ²	Data Quality
	PV Algo & Action Algo ³	Alarm Enable & Status	Message Index
	Scan Address (PV SP MD Au)	Scan Period (PV SP MD Au)	Manual PV
	User Defined Parameters ⁴	Non-scanned Parameters ⁵	Point Script ⁶
Analog (Used for continuous analog values)	Process Variable (PV)	Output (OP)	Setpoint (SP)
	Mode (MD)	Up to 4 Auxiliary inputs (Au) ⁷	Engineering Units (EU)
	0% & 100% EU Range	Drift Deadband	PV Clamp
	PV Bias & Scale	Normal Mode	OP Low & High Limits
	SP Low & High Limits	Reverse Output	Operator Control Level
	Control Inhibit	Control Confirmation	Control Deadband
	PV Fail Alarm	PV Control Timeout	PV Control Fail Alarm
	External Change Alarms	Unreasonable PV Alarm	Up to 8 PV Alarm types ⁸
	Alarm Deadband		
Status (Used for digital values. PV can range from 1 bit to 3 bits, allowing up to 8 states.)	Process Variable	Output	Mode
	Normal Mode	Number of Input States	Number of Output States
	State Descriptor 0 to 7	InState Flags	Target PV for OP States
	Reverse Output	Output Pulse Width	Operator Control Level
	Control Inhibit	Control Confirmation	PV Control Timeout
	PV Control Fail Alarm	Alarm States (0 to 7)	Re-Alarm between states
	External Change Alarms		
Accumulator (Used to totalize a pulsed input)	Process Variable	Engineering Units (EU)	100% EU Range
	Meter Factor	Scale Factor	Roll Over Value
	Raw PV	Up to 4 PV Alarm types ⁹	
OPC Advanced (to link complex OPC data structures)	Point Name	Point Description	Item Name
	Parent Asset	Associated Display	Point & Group Displays
	User Defined Parameters ⁴	OPC Parameters ¹⁰	Point Script ⁶
Container (Collates many related points into 1)	Point Name	Point Description	Item Name
	Parent Asset	Associated Display	Template Type
	Contained Points ¹¹		

Point Structure	Standard Parameter
Note 1 –	Each of the configured alarms can be assigned a priority ranging from Journal, Low, High to Urgent. An alarm sub-priority (0 to 15) can also be assigned to further differentiate alarms.
Note 2 –	Each time the PV is polled from the RTU, Experion will track the time/date of when the value was last processed. If the Analog point in Experion has a drift deadband of 1%, then the last processed time is not updated until the PV moves by >1%. Similarly, if the drift deadband is 0%, then the last processed time is not updated until the PV moves slightly.
Note 3	Experion supports additional data processing through the use of standard algorithms that may be attached to analog, status or accumulator points. Functions provided by these algorithms include: Arithmetic calculation; Boolean calculation; Maximum/minimum value; Integration; Run hours totalization; Group alarm inhibit; Report request; Application program request;
Note 4 –	For each of the point types it is possible to add user-defined parameters to the existing pre-built parameters. This enables points to be extended to contain free format values, constant values, or values used by applications and scripts to store calculated or derived plant information. User-defined parameters can be assigned to history collection.
Note 5 –	Only relevant for OPC Client type controllers: Non-scanned parameters are similar to user defined parameters except they link to a controller OPC item. These parameters are only requested on demand, (not scanned). Useful to access related information stored in the controller.
Note 6 –	Point Script: Custom VBScript executed based on triggers. Available triggers: OnAlarm; OnNormal; OnAcknowledge; OnTimer; OnChange (by parameter); OnOperChange (by parameter). See server Scripting section below.
Note 7 –	Auxiliary Inputs are typically used for PID tuning constants but may have other uses.
Note 8 –	Supported alarms include: PV Hi, PV Lo, PV HiHi, PV LoLo, Deviation Hi, Deviation Lo, Transmitter Hi, Transmitter Lo, Rate of Change.
Note 9 –	Supported alarms include: PV Hi, PV HiHi, Rate of Change.
Note 10 –	OPC Parameters: Each OPC parameter has a parameter name and associated OPC item definition.
Note 11 –	Each contained, (or child), point of a Container point has an alias that becomes the first part of the Container point parameter. E.g., <Container>.<Alias>.PV

1.9.3. Algorithm Blocks

Experion supports additional data processing through the use of standard algorithms that may be attached to analog, status or accumulator SCADA points. Functions provided by these algorithms include: Arithmetic calculation; Boolean calculation; Maximum/minimum value; Integration; Run hours totalization; Group alarm inhibit; Report request; Application program request; Some of these require the use of Algorithm Blocks.

Items	Specifications	Comments
SCADA Point Algorithm Blocks	50,000	This is the maximum number of algorithm blocks for a given server. Algorithms are optionally attached to SCADA points. Some algorithm types require the use of an algorithm block.

1.9.4. Equipment Templates

Equipment is a licensed point type that provides simplified engineering and enhanced Station visualization of similar pieces of physical equipment, (such as Gas Wellheads). Equipment is created in Quick Builder and automatically builds underlying SCADA points, Controllers and Station visualizations based on a configured template. Equipment point limits are detailed in section 1.4.1, **Error! Reference source not found.**

Item	Specification
Maximum Equipment Templates	200 (20 types with 10 variants each)
Maximum Equipment Template inheritance ¹ depth	4
Note 1 – Inheritance is about a variation or specialization of a piece of equipment. For example: <ol style="list-style-type: none"> 1) Pumping Well and Flowing Well both inherit from Well – this is an inheritance level of 1 2) Turbo Pumping Well inherits from Pumping Well which inherits from Well – inheritance level of 2 	

1.10. Server Scripting

1.10.1. General Server Scripting Specification

Items	Specifications	Comments
Description		
Server scripting extends the behavior of the server-resident subsystems and its run time objects. Examples of server objects are points and parameters, reports, assets and tasks (application programs). Scripts can run by the server either periodically or when a specified event occurs. Standard displays support the monitoring of the status of running scripts.		
General Specifications		
Maximum script size	Short scripts only (typically less than 50 lines)	<ul style="list-style-type: none"> Server scripting has been optimized for relatively short scripts and is not designed for implementing control strategies. If a task is computationally intensive, or requires extensive file handling, custom applications can be used instead of scripts – see section 3.6 “Application Development Toolkit”. Some tasks qualify for both categories, and the rules are flexible when deciding what tasks can and cannot be performed by server scripts, see the following section. Where possible, existing server functionality should be used in preference to writing server scripts. Standard server functionality optimizes the task implementation.

1.10.2. Server Scripting versus Custom Applications

Tasks	Server Scripting	Custom Application
Extend server functionality via information transfer	Yes	Yes
Relatively short processing (< 50 lines of code)	Yes	Yes
Used to provide linkage to other applications via automation servers	Yes	Yes
Code is interpreted at run-time.	Yes	No
Code is compiled and optimized at build time.	No	Yes
Computationally intensive	No	Yes
Optimized for supervisory control	No	Yes
Iterative code	No	Yes
Relatively complex user interface requirements	No	Yes
Extensive file handling	No	Yes
Script (program) state preserved on failover	No	No
Language	VBScript	Visual Basic, C++, etc.

2. Option Specifications

2.1. Server Redundancy

Items	Specifications	Comments
Description		
Server redundancy provides a high availability platform by enabling a pair of similarly configured Servers to support each other in a primary/backup fashion.		
Details		
Redundancy fail-over conditions	Should the primary Server fail, a fully functioning backup assumes the primary role.	Primary refers to the specific Server that is actively acquiring data from the controllers/RTUs and serving data to the clients. The primary Server propagates all database transactions to the backup to enable both databases to remain synchronized.

2.2. Distributed Systems Architecture (DSA)

2.2.1. General DSA Specifications and Performance

Items	Standard Capacity System	High capacity system	Comments
Description			
Distributed System Architecture (DSA) is an option that enables multiple Experion LX Servers to share data, alarms, alerts, messages and history without the need for duplicate configuration on any Server.			
Maximum number of DSA connected servers	5	5	This is the total number of Experion LX Servers on the network. They do not all need to be connected to each other via DSA or be in the same Enterprise Model system. Note the increased limit for Central Control Room topologies below
DSA Data Publish			
Maximum number of parameters/s to all remote servers ¹	1500	1500	
Maximum number of remote servers for publishing to	5	5	
DSA Data Subscription			
Maximum number of parameters/s from each remote server ¹	0	1000	
Maximum number of remote servers that this server can subscribe to	0	5	
Total number of parameters/s from all remote servers	0	5000	

DSA Request Response			
(Device read) Maximum number of list reads from DSA Server per second	1	1	
(Device read) Maximum number of items/list supported ^{1,2}	1000	1000	
(Device read) Sustained read rate (items/second) ^{1,2}	250	250	
<p>Note 1 – Ability to deliver published data rate depends upon throughput of underlying process control network.. Refer to the documentation associated with the process control network for more information.</p> <p>Note 2 – Device reads should be used with caution. It is possible to overload the underlying process control network if too many device reads are done.</p> <p>Note 3 – These values are based upon the standard history configuration settings</p>			

2.2.2. DSA Central Control Room

DSA Central Control Room Topology ¹		
	Standard Capacity System	High capacity system
Maximum number of remote servers that this server can subscribe to	0	5
<p>Note 1 – The DSA Central Control Room (CCR) topology is a topology where an Experion LX Server is a subscriber to a large number of remote DSA servers. The key features of this topology are:</p> <ul style="list-style-type: none"> • The CCR server is not process connected • The CCR server can be redundant • The CCR server has its own EMDB. All remote servers are external servers in CCR server EMDB. • The remote servers must obey the standard DSA limits (including the maximum number of remote servers that this server can subscribe/publish to) • The CCR server must obey the standard DSA limits (except for the maximum number of remote servers that this server can subscribe to) 		

2.2.3. DSA Interoperability

Experion LX can publish data to Experion PKS system, and cannot subscribe data to Experion PKS system. Experion LX can subscribe and publish data to Experion HS system; and Experion HS can also subscribe and publish data to Experion LX system.

2.3. CDA Integration with Safety Manager

Safety Manager CDA Integration Specifications	
High Capacity	
Definitions: <i>PPS = Average Parameters Per Second</i> <i>PPM = Average Parameters Per Minute</i>	
Safety Manager CDA Points	Per Server Cluster

Safety Manager CDA Integration Specifications	
High Capacity	
Maximum CDA points published from Safety Builder per Experion Server Cluster (includes all Safety Managers associated with the cluster)	2500 Points
Overall Data Access Performance	Per Safety Manager
Maximum Total Parameter Access Response Rate <i>(Includes all Server Data Requests, Console Station Data Requests, and peer communications including other ACEs, C200s, C300s, SIM-C200s, SIM-C300s, SIM-ACEs, and FIMs)</i>	600 PPS
Display Data Access Capacity	
Maximum Total Subscribed Parameters per SM <i>(Includes all Server Data Requests + Console Station Data Requests)</i>	1200
Maximum time for CDA to reform display connections after redundant SM failover	6 sec
Request/Response Data Access Performance	
Max Request/Response Parameter Access Rate <i>(Includes all Slow Server Data Requests, e.g. Greater than 10 sec OPC data, Slow History, Data Writes, etc.)</i>	2000 PPM Read 500 PPM Write
Peer-to-Peer Performance	
Maximum Initiator Pull/Get Subscribe Rate to all target nodes. (incoming data)	NA ¹
Maximum Target Publish Rate to Pull/Get Subscriptions from all initiator nodes. (outgoing data) ²	100 PPS
Maximum time for CDA to reform peer connections after redundant SM failover	3 sec
Peer-to-Peer Subscription Capacity / Update Rate	
Maximum SM peer capacity per update rate (Pulling data from SM)	20 @ 200 ms 50 @ 500 ms 100 @ 1 sec
Push/Store Request Performance	
Maximum Push/Store Request Rate to all target nodes ¹	NA
Maximum Response Rate to Push/Store Requests from all initiator nodes	20 PPS
Maximum Number of parameters that can be Written to Safety Manager from C300 (single writes exclusively)	64 per cycle ⁴
Peer-to-Peer Capacity	
Peer Connection Units (PCUs) <i>(Number of CDA Controllers that this SM can respond to)^{1,3}</i>	20 <i>(Includes total of other ACEs, SIM-ACEs, C200Es, C300s, SIM-C200Es, SIM-C300s)</i>
Notes: 1 – Safety Manager is only a CDA Data Responder Node. SM does not initiate any Peer-Peer connections. 2 – Outgoing peer data capacity is defined/measured before the RBE (Report by Exception) comparisons are done, so all parameters requested as peer data contribute to the outgoing PPS load, whether they are changing or not and sent over the network or not. 3 – Each CDA Peer-Peer connection to the redundant Safety Manager consumes 2 CDA connections (PCUs) on the C200E, C300, or ACE Node. (1 connection to the Primary SM plus 1 connection to the Secondary SM) 4 – “Cycle” refers to the Safety Manager application cycle (See write calculation in the prior section)	

2.4. OPC

2.4.1. OPC Client Interface (SCADA Client)

Items	Specifications	Comments
Description		
The OPC Client Interface is designed primarily for robust integration of low complexity subsystems such as Programmable Logic Controllers (PLCs) and Remote Terminal Units (RTUs). It provides an open method for connecting a wide range of devices for supervisory monitoring, alarming and control.		
General OPC Client Interface Specifications		
Maximum number of third-party OPC DA servers supported by the Experion LX OPC DA Client	5	
OPC DA versions supported	1.0a and 2.05a	
Supports redundant OPC DA Servers	Yes	The OPC Client Interface natively supports the concept of preferred and secondary servers. However, it only supports passive redundancy, requiring the interface to rebuild the items and groups on the secondary in the event of a primary failure. This will give acceptable performance for a moderate number of items.
Time-stamping	Within the Experion LX Server	Time-stamping of the data occurs within the Experion LX Server once the data has been successfully read into the SCADA database
Alarming	Yes	Alarms are generated based on limits defined within the Experion LX Server.
Scannable parameters per point	8 – Analog 3 – Digital 1 – Accumulator	<ul style="list-style-type: none"> A scannable parameter is a parameter that is able to source data from an OPC Item versus an internal register. These are the standard quantities of scannable parameters found on all SCADA analog, digital and accumulator points.
OPC Groups and Items		
Maximum number of OPC controllers	50	This is the maximum number of SCADA controllers/RTUs that can be built across all channels on an Experion LX Server.
Maximum number of items per OPC controller	960	This is the total number of OPC Items that can be built against a given controller. There will be a varying number of items consumed with each point, up to 8 for an analog point.
Maximum number of OPC groups supported	500	<p>An OPC client controller manages groups as follows:</p> <ul style="list-style-type: none"> A group is created for each scan period used by the point parameters (items) defined on the controller. All point parameters that have the same scan period are placed in the same group. Note that if a scan period of 0 is used, the item is placed in a group with an update rate equal to the slowest scan rate of the system. All points defined on the controller have the same OPC deadband. Note that the OPC deadband is not the same as the alarm and control deadbands that can be specified for analog points.
Maximum number of items per scan period per controller	960	As above.
Rate at which items can be added to groups	1,000/second	The rate at which items can be added to groups depends upon the design of the OPC Server and the throughput of the process control network with which it connects.
OPC group update rates	1 second and above	The group rates supported match the Experion LX scan rates

Items	Specifications	Comments
supported		supported.
OPC Client Callback Support		
Sustained callback rate from all OPC servers (values per second)	1,000	
OPC client write support		
Number of item writes by OPC client interface per second (per channel)	1	
Maximum no. of items per list supported (write)	10	
Sustained write rate (items/second)	1	

2.4.2. OPC Advanced Data Client

Items	Specifications	Comments
Description		
The Experion OPC Advanced Data Client is designed to facilitate the efficient reading of data between Experion and OPC Data Access servers that have very complex point structures. These point structures typically would have a large number of parameters per point and many different point types. The Experion OPC Advanced Data Client is bundled with the OPC Client Interface option.		
General OPC Advanced Data Client Specifications		
Maximum number of third-party OPC servers supported	5	
OPC DA versions supported	2.05a	
Redundancy supported	Yes	The OPC Advanced Data Client has no native redundancy like the OPC Client Interface; however, Redirection Manager can be used to provide redundancy support. With support for active redundancy schemes, Redirection Manager is able to build items and groups simultaneously on the OPC DA servers. This allows for extremely fast switching in the event of an OPC DA failure
Maximum OPC item name length	120 char	Maximum total length of an OPC item name that can be used with the OPC Advanced Data Client
Alarming	No	Unlike the OPC Client Interface, the OPC Advanced Data Client relies on the OPC Advanced Alarm and Event client for alarming capabilities. It has no native ability to alarm without the presence of an OPC Alarm and Event (A&E) server. In order for the OPC Advanced Alarm and Event client to provide alarming capabilities, condition-based OPC alarms are required from the OPC A&E server. Because of the many different interpretations of the OPC A&E standard by third-party vendors, integration issues with OPC condition events in areas such as alarm acknowledgement and duplicate alarm identification may exist. Contact Honeywell for planning assistance when integrating a third-party OPC A&E server that utilizes OPC condition events with Experion.
Scanned parameters per point	400	
OPC Groups and Items		

Items	Specifications	Comments
Maximum number of OPC groups supported	See note	The OPC Advanced Data Client manages groups as follows: a group is created for each subscription rate used by local and remote clients. That is, all point parameters that have the same subscription rate are placed in the same group. When an item is no longer being subscribed to, it will be removed from its current group.
Maximum number of items per group supported	2,000	
Maximum number of items across all groups	10,000	
Group update rates supported 1 second and above ^{1,2}	1 second and above ^{1,2}	
OPC Client Callback Support		
Sustained callback rate from all OPC servers (values per second)	1,000 ²	
OPC Client Write Support		
Number of item writes by OPC client interface per second	4	
Maximum no. of items per list supported (write)	2,000 ¹	
Sustained write rate (items/second)	500 ¹	
<p>Note 1 – This value depends upon the design of the third-party OPC server and the throughput of the process control network with which it connects.</p> <p>Note 2 – The group rates supported match the Experion subscription rates supported up to the maximum subscription rate (default: 10 seconds). Beyond the maximum subscription rate synchronous reads are used to collect the data.</p>		

2.4.3. OPC Display Data Client

Items	Specifications	Comments
Description		
Primarily targeted as a convenient method of getting OPC Data into displays. Designed for situations where you need to bring data into the Experion LX displays via OPC and no additional processing needs to be done on the server e.g. no need for alarming, historization, point detail, group, etc. The Experion LX OPC Display Data Client is bundled with the Experion LX base software.		
General OPC Display Data Client Specifications		
Maximum number of third-party OPC servers supported	5	
OPC versions supported	2.05a	
OPC Performance and Throughput		
Maximum number of OPC groups supported	See Comment	The OPC Display Data Client manages groups as follows: a group is created for each subscription rate used by local and remote clients. That is, all point parameters that have the same subscription rate are placed in the same group. When an item is no longer being subscribed to, it will be removed from its current group.
Maximum number of data values per display	40	The performance of third-party OPC Servers can vary significantly. For very slow OPC Servers it is possible that the maximum number of OPC display data client values per display may be less than this.
Maximum number of data values per OPC server	1,000	
Display rates supported	1 second and above	This value depends upon the design of the third-party OPC server and

		the throughput of the process control network with which it connects.
OPC client callback support		
Sustained callback rate from all OPC servers (values per second)	100	The performance of third-party OPC servers can vary significantly. For very slow OPC servers it is possible that the maximum number of OPC display data client values per display may be less than this.

2.4.4. OPC Data Access Server

Items	Specifications	Comments
Description		
The Experion LX OPC Data Access Server provides OPC Data Access Clients with the capability to view Experion LX point data for the purposes of control and plant-wide historization.		
General OPC Data Access Server Specifications		
Maximum number of OPC Data Access Client Application Instances (CAIs)	20	Each OPC Client Application running on a physical node connecting into the server consumes one Client Application Instance (CAI) for each application. The applications can open multiple physical connections and this still only counts as one CAI for each application. If the same application is running on multiple nodes, one CAI is consumed for each node.
Maximum number of concurrent OPC DA connections across all OPC clients	50	
OPC DA versions supported	1.0 and 2.05a	
Redundancy supported	Yes	Redirection Manager should be used for connecting clients that do not support redundancy to the redundant Experion LX Servers. For clients that do support redundancy, use of Redirection Manager is still advised as it has been designed with Experion LX's redundancy scheme in mind.
OPC Groups and Items		
Maximum number of OPC groups supported	300	
Maximum number of items per group supported	7,000	
Rate at which items can be added to groups	1,000/second	Assumes the parameters are already primed. The rate at which items can be added to groups depends upon the throughput of underlying process control network.
Total number of items supported across all groups	50,000 ¹	
Group update rates supported	1 second and above	
OPC Client Callback Support		
Sustained callback rate from OPC server (items per second) to all OPC clients	2,000 ¹	
OPC Client Read Support		
(Cache read) Maximum number of list reads from OPC server per second	1	
(Cache read) Maximum number of items/list supported	2,000 ¹	Assumes that the data is already subscribed to and is therefore in the Experion LX cache.
(Device read) Maximum number of list reads from OPC server per second	1	
(Device read) Maximum number of items/list supported	2,000 ^{1, 2}	

Items	Specifications	Comments
(Device read) Sustained read rate (items/second)	500 ^{1, 2}	
OPC Client Write Support		
Number of list writes to OPC server per second	1	
Maximum no. of items per list supported (write)	2,000 ³	
Sustained write rate (items/second)	500 ³	
<p>Note 1 – Ability to deliver published data rate depends upon throughput of underlying process control network. . Refer to the documentation associated with the process control network for more information.</p> <p>Note 2 – Device reads should be used with caution. It is possible to overload the underlying process control network if too many device reads are performed.</p> <p>Note 3 – The ability to deliver write data rate depends upon the throughput of underlying process control network.</p>		

2.4.5. OPC Alarm and Event Server

Items	Specifications	Comments
Description		
The OPC Alarm and Event Server is a simple and convenient mechanism for publishing Experion LX alarms and events to client applications. It provides a rich range of different Experion LX alarm and event data in an efficient manner, using the latest version of OPC specification.		
General OPC Alarm and Event Server Specifications		
Maximum number of Alarm & Event Client Application Instances	15	Each OPC Client Application running on a physical node connecting into the Server consumes one Client Application Instance (CAI) for each application. The applications can open multiple physical connections and this still only counts as one CAI for each application. If the same application is running on multiple nodes, one CAI is consumed for each node.
OPC A&E versions supported	1.1	
Redundancy supported	Yes	Redirection Manager should be used for connecting clients that do not support redundancy to the redundant Experion LX Servers. For clients that do support redundancy, use of Redirection Manager is still advised as it has been designed with Experion LX's redundancy scheme in mind.
Event types supported ¹	Condition, tracking and simple	<p>Condition-related events are associated with OPC conditions (e.g. Acked, UnAcked, Disabled etc.). An example is the tag FIC101 transitioning into the LevelAlarm condition and HighAlarm sub-condition.</p> <p>Tracking-related events are not associated with conditions, but represent occurrences which involve the interaction of an OPC Client with a "target" object within the OPC Event Server. An example of such an event is a control change in which the operator, (the OPC Client), changes the set point of tag FIC101 (the "target").</p> <p>Simple events are all events other than the above. An example of a simple event is a component failure within the system/device represented by the OPC Event Server.</p>
Experion LX alarm and event types published	Alarms, alerts, messages, events, SOE, operator	

	changes	
OPC Performance and Throughput		
Maximum notification rate to one OPC A&E client	15,000/hour	The maximum notification rate is the total number of notifications received by the server from all sources. The maximum A&E notification rate is dependent on the total number of notifications being received by the server from all sources.
Maximum notification rate to all OPC A&E clients	10,000/hour	As above.
<p>Note 1— Because of the many different interpretations of the OPC A&E standard by third-party vendors, integration issues with OPC condition events in areas such as alarm acknowledgement and duplicate alarm identification may exist. Contact Honeywell for planning assistance when integrating a third-party OPC A&E Client that utilizes OPC condition events with Experion LX.</p> <p>The risks with OPC simple and tracking events are lower than for OPC condition events. However, because of different interpretations of the OPC AE standard, integration issues may still be found. Thorough testing should be performed between the Experion LX OPC A&E Server and third party client to ensure correct operation.</p>		

2.4.6. OPC Historical Data Access Server

Items	Specifications	Comments
Description		
The OPC History Data Access Server presents Experion LX history data in an open manner to client applications. Whether archived or online, the Experion LX OPC history data is able to retrieve and publish data timely and efficiently. A range of aggregate functions are provided to reduce the processing load on the client.		
General OPC Historical Data Access Server Specifications		
Maximum number of History Data Access Client Application Instances	20	Each OPC Client Application running on a physical node connecting into the server consumes one Client Application Instance (CAI) for each application. The applications can open multiple physical connections and this still only counts as one CAI for each application. If the same application is running on multiple nodes, one CAI is consumed for each node.
Maximum number of concurrent OPC HDA connections across all OPC clients	40	
OPC HDA version supported	1.2	
Redundancy supported	Yes	Redirection Manager should be used for connecting clients that do not support redundancy to the redundant Experion LX Servers. For clients that do support redundancy, use of Redirection Manager is still advised as it has been designed with Experion LX's redundancy scheme in mind.
Supported aggregates	Interpolated, average, minimum and maximum	
Performance and Throughput		
ReadRaw (average values per second)	3500 ^{1, 2}	
AdviseRaw (average values per second)	1200 ^{1, 2}	
ReadProcessed (average values per second)	500 ^{1, 2, 3}	
Note 1 – A minimum of 10 point.parameters per call are required to achieve this performance.		

Items	Specifications	Comments
Note 2 – The specification for value/second is across all clients.		
Note 3 – ReadProcessed performance is for interpolation aggregate.		

2.4.7. OPC Integrator

Items	Specifications	Comments
Description		
OPC Integrator allows bi-directional data transfer between two or more OPC Data Access Servers for the purposes of supervisory monitoring, alarming and control. As a fully integrated part of Experion LX, it provides integrated diagnostic, configuration and operational experiences that are consistent with other Experion LX operations. Additionally OPC Integrator leverages Experion LX's advanced redundancy features for improved reliability.		
General OPC Integrator Specifications		
OPC DA versions supported	2.05a	
Maximum number of OPC Integrator transfer groups supported	Unlimited	A typical large system consists of approximately 40 groups.
Maximum number of items per group	Unlimited	Typical large systems will contain approximately 1000 items per group.
Transfer rates supported	500ms and above	<ul style="list-style-type: none"> Typically set between 1 and 10 seconds. Ability of OPC Integrator to support a given transfer rate depends on the underlying OPC Data Access Server that it is connected to. Setting this number too low can impact performance.
Rate at which items can be added to groups	1,000/second	Assumes the parameters are already primed. The rate at which items can be added to groups depends upon the design of the third-party OPC server and the throughput of the process control network it connects to.

2.4.8. Redirection Manager

Items	Specifications	Comments
Description		
Redirection Manager (RDM) provides OPC server redundancy to OPC Data Access, Alarm and Event, and History Data Access Clients that may not support this capability by transparently redirecting client requests to a secondary OPC server when the primary OPC server is unavailable.		
Version Support		
OPC versions supported	<ul style="list-style-type: none"> OPC DA versions 1.0 and 2.05a OPC A&E version 1.1 OPC HDA version 1.2 	

2.5. Interfaces

Interface Software ¹	Connection Type
DNP3 Protocol Interface ^{1, 4}	Open Standard Serial and Ethernet (TCP/IP & UDP/IP)
Modbus (RTU, Plus, ASCII, & TCP) Interface ¹	Serial, Modbus+, ASCII and Ethernet
Honeywell Universal Modbus Interface ¹	Serial and Ethernet
MLDP MasterLogic Interface	Ethernet
Enron Modbus Interface ²	Serial through Terminal Server (RTU or ASCII) and Ethernet
OPC Client Interface ³	Dependent on OPC server used
IEC 61850 protocol Interface	Ethernet
<p>Note 1 – These interfaces together with the Honeywell Safety Manager and MasterLogic PLC Serial and Ethernet Integration are standard included with the Experion LX base software</p> <p>Note 2 – Comes with an EFM custody transfer data option. Requires the use of EFM meter points</p> <p>Note 3 – Numerous third party devices are supported using the OPC Client Interface in combination with MatrikonOPC drivers</p> <p>Note 4 – Requires separate license for a history backfill option</p>	

2.6. Microsoft Excel Data Exchange

Item	Specification
Description	
Enables capture of real-time point parameter and history information, and displays the data in a Microsoft Excel spreadsheet, using cell formulas or the Microsoft Excel Data Exchange Wizard.	
Details	
Access to real-time point.parameter values	Read or Read/write access (configurable)
Access to historical point.parameter values	Read only
Access to database files (user tables)	Read or Read/write access (configurable)

2.7. Application Development Toolkit

2.7.1. ODBC Driver

Item	Specification
Description	
Primarily intended for reporting, the ODBC driver enables an ODBC-compliant application to access data in the Experion database, such as history, event, and point parameter values. With the ODBC Driver, the Experion Server acts as a server application (contrast this with ODBC Data Exchange, where the Experion Server acts a client application). The ODBC Driver allows the server database to be queried using SQL commands from ODBC client applications. Additionally, custom applications written in Visual Basic or C++ can also access the server database via the ODBC driver.	
Details	

Access to real-time point.parameter values	Read only
Access to historical point.parameter values	Read only
Access to events	Read only
Configuration	Optimized for Microsoft Access and other ODBC ad hoc query/report applications.

2.7.2. ODBC Data Exchange

Item	Specification
Description	
Enables two-way exchange of data between the Experion Server database and an ODBC-compliant local or network third-party database. It uses standard Structured Query Language (SQL) commands. The Experion Server acts as a client application in this configuration, in contrast with the ODBC Driver option where the Experion Server acts a server application. Data from an Experion Server database can be transferred to a third-party database, and data from a third-party database can be transferred into the Experion Server database.	
Details	
Access to real-time point.parameter values	Read/write access
Access to historical point.parameter values	Read only
Access to database files (user tables)	Read/write access
Databases that include ODBC drivers examples	Microsoft SQL server, Oracle 7, Microsoft Access, and Sybase 10.
Configuration options	Can be configured to periodically exchange data or exchange on request.

2.7.3. Network API

Item	Specification
Description	
Support custom applications — In Visual C/C++ or Visual Basic — that exchange data with the Experion database.	
Details	
Access to real-time point.parameter values	Read/write access
Access to historical point.parameter values	Read only
Access to database files (user tables)	Read/write access

2.8. Application Enablers

2.8.1. Point Control Scheduler

Item	Specification
Description	
The Scheduler option allows point supervisory control to be automatically scheduled to occur at a specified time. This may occur on a "one-shot" basis, daily, workday, weekend, holiday, or a day of the week.	
Details	
Maximum number of point control schedules	1,000

2.8.2. Recipe Management

Items	Specifications	Comments
Description		
Recipe Management provides facilities to create recipes and download them to nominated process units. Each recipe may have up to 30 items and recipes can be chained together to form larger recipes, if required. Recipe items may be used to set ingredient targets, set alarm limits, set timers and place equipment into correct operating state. Items may be individually enabled for scaling.		
Details		
Maximum number of recipes	500	This is the default limit. This number can be increased to 32,000 if required.

2.8.3. Batch Reporting

Items	Specifications	Comments
Description		
Batch reporting enables integrated reporting of batches or lots of a production process run, to be compiled and archived automatically by the Experion LX Server. This feature is standard included in the Experion LX base software.		
Details		
Maximum number of history samples per batch report	65,000	A batch report can collect one type of history sample (such as 5-second samples or 1-hour averages) for up to 50 points.

2.8.4. Alarm Pager

Items	Specifications	Comments
Protocols		
	<ul style="list-style-type: none">• Paging Entry Terminal (PET)• Telocator Alphanumeric Protocol (TAP)• UCP protocols• UCP 01• UCP 30• UCP 51	Service providers in North America generally use the PET or TAP protocols where as the UCP protocols are mainly used in Europe. The two-digit suffixes refer to the EMI command numbers used by the provider.
Sizing		
Number of pagers	100	Each pager and email address can be configured with an individual schedule of operation so that users are only paged when they are on call.
Number of email addresses	100	
Delays		
Configurable notification delays	0 - 60 minutes	

2.8.5. Server Peer Responder

Items	Specifications	Comments
-------	----------------	----------

Items	Specifications	Comments
Description		
Server peer responder provides the capability for CEE based controllers to form direct Peer-Peer data references to Experion Server resident points and parameters such as SCADA, OPC, OPC Advanced Points, Point server, and DSA (remote) point types. No Peer-Peer transactions can be initiated from the Experion Server.		
Details		
Maximum number reads points	1,200/second	Maximum number of read parameters by CEE's per server of point type SCADA, OPC, point server and DSA
Maximum number writes points	400/second	Maximum number of write parameters by CEE's per server of point type SCADA, OPC, point server and DSA
Redundant server Failover in minutes	1 minute	Maximum Time for CDA on the server to re-establish Peer-Peer connections to controllers after a backup server becomes primary server following failover

2.8.6. Dynamic Alarm Suppression

Items	Specifications	Comments
Description		
Dynamic alarm suppression enables a user to reduce alarm floods or the number of standing alarms by removing an alarm or group of alarms from the summary when an initiating alarm has occurred.		
Details		
Maximum number of triggers across all groups per server	700 triggers	
Maximum number of suppressible alarms across all groups per server	3000 alarms	Suppression groups are configured at a system level and downloaded to all servers. Each server and console station applies the suppression to their alarms independently.

3. Hardware and Software Requirements

3.1. Experion LX Server Computer Requirements

A computer must meet the following specifications to be used as a Experion LX Server. These guidelines are intended to provide a minimum baseline. Honeywell computer platforms will meet these specifications and carry full support as a qualified offering. For installation information on computer platforms, including physical, electrical, corrosion, and other environmental requirements, please consult Honeywell installation guides or Dell documents.

Server System Performance Sizing Chart	
System Configuration	System "Type"
Systems with up to: <ul style="list-style-type: none"> 4000 SCADA points 8000 Process Points 10 Direct Stations Redundancy 	Standard Capacity
Systems with up to: <ul style="list-style-type: none"> 8000 SCADA points 10000 Process Points 5 DSA Connected Servers 15 Direct Stations 10 Flex Stations Redundancy 	High Capacity-T110 II Server PC
Systems with up to: <ul style="list-style-type: none"> 50000 SCADA points 10000 Process Points 5 DSA Connected Servers 15 Direct Stations 10 Flex Stations Redundancy	High Capacity-T320 Server PC
Systems with maximums specified in the Server Spec	High Capacity-R710 Server PC

3.1.1. Server Hardware Requirements

System Configuration	Standard Capacity	High Capacity – T110 II	High Capacity – R710
Processor	3 GHz or Faster	Intel Xeon X3440 Xeon CPU, 2.53GHz, 8M Cache	Xeon X5560 Processor 2.8GHz Turbo HT (or better) Quad Core.
RAM	3 GB	3 GB	4 GB
Networking	100 Mbps Ethernet or FTE	100 Mbps Ethernet	100 Mbps Ethernet
Video Resolution	1024 x 768 65K colors	1024 x 768 65K colors	1024 x 768 65K colors
Video RAM	8 MB	8 MB	16 MB
Operating System	Windows 7 64 bit	Windows 2008 R2 64-bit	
Browser type	Microsoft Internet Explorer 7		
Hard Drive	500 GB	1TB	160 GB
Example Hardware for LX Server	DELL OptiPlex 3020 HP ProDesk 600 G1 Tower PC	Dell PowerEdge T110 II Dell PowerEdge T320	Dell PowerEdge R710
Display Card	ASUS Display Card HD6670-2GD3		

Note 1 – The systems listed here are examples of platforms that will meet or exceed the recommended specifications.

3.1.2. Server Hardware Requirements

Network	Comments
Fault Tolerant Ethernet ¹	Honeywell's patented Fault Tolerant Ethernet (FTE) network uses off-the-shelf networking hardware to allow Ethernet to provide "DCS network" functionality. FTE provides a robust and high availability network infrastructure for communicating to Experion LX Direct Stations, C300 controllers, etc.
Network Interface Cards	Broadcom 5720 (PCIe) (Dual Port) and Broadcom 5722 (PCIe) (Single Port)
Switches	Huawei LS-S2326TP-EI-AC, Dlink DES-3528
<p>Note 1 - The FTE solution employs a single logical network over redundant media. By providing more communication paths between nodes, FTE also tolerates more faults, including all single faults and many multiple faults. In addition, FTE is transparent to higher-level applications, which benefit from the high network availability that FTE provides, without requiring any additional software configuration. Normal Ethernet nodes (non-FTE) can also connect to an FTE network and benefit from a more available communications environment than conventional Ethernet redundancy schemes offer.</p>	

4. Model Numbers

4.1. Server Database

Model Number	Description
LX-DBASE1 ¹	Experion LX Base Software
LX-DPR100 LX-DPR01K LX-DPR02K LX-DPR05K LX-DPR10K	100 PROCESS PTS, Non-Redundant 1,000 PROCESS PTS, Non-Redundant 2,000 PROCESS PTS, Non-Redundant 5,000 PROCESS PTS, Non-Redundant 10,000 PROCESS PTS, Non-Redundant
LX-DSC100 LX-DSC01K LX-DSC02K LX-DSC05K LX-DSC08K LX-DSC10K LX-DSC25K LX-DSC50K LX-DEQ100	100 SCADA PTS, Non-Redundant 1,000 SCADA PTS, Non-Redundant 2,000 SCADA PTS, Non-Redundant 5,000 SCADA PTS, Non-Redundant 8,000 SCADA PTS, Non-Redundant 10,000 SCADA PTS, Non-Redundant 25,000 SCADA PTS, Non-Redundant 50,000 SCADA PTS, Non-Redundant 100 Equipment Point Adders to Database Size
<p>Note 1 – Every Experion LX Server requires base software at a minimum. The base software includes the following items: 1 Experion LX Direct Station, 2 Experion LX Flex Station, 1 Display Builder Client, 100 SCADA points, 100 Process points, 1 Quick Builder License, Redirection Manager, OPC Display Data Client, Honeywell Safety Manager Integration, Batch Reporting, 1 Display Builder License, 1 Control Builder Client License (enables the configuration of control strategies for CDA devices such as the C300), Control Builder Template Support, CDA Subsystems Interface, Enterprise Model Builder, Honeywell Universal Modbus Interface and Backfill, Experion LX Recipe Manager, 1 Microsoft Excel Data Exchange Licenses, DSA Publish, Multiple Display Support, 127 PCDI, History Collection/Archiving, Events Collection/Archiving, Chart Monitoring, Reporting, Alarm Event Report, Alarm Duration Report, Alarm Metrics, Alarm Group, Excel Report, C300 Control Solver -50ms, DNP3 Interface and OPC Client Interface Licenses. The base license also includes other options and interfaces as listed in the Experion LX Server License Specification.</p>	

4.2. Server Redundancy

Model Number	Description
LX-RBASE1	Redundancy Base Adder
LX-RPR100 LX-RPR01K LX-RPR02K LX-RPR05K LX-RPR10K	100 PROCESS PTS, Redundancy Adder 1,000 PROCESS PTS, Redundancy Adder 2,000 PROCESS PTS, Redundancy Adder 5,000 PROCESS PTS, Redundancy Adder 10,000 PROCESS PTS, Redundancy Adder
LX-RSC100 LX-RSC01K LX-RSC02K LX-RSC05K LX-RSC08K LX-RSC10K LX-RSC25K LX-RSC50K	100 SCADA PTS, Redundancy Adder 1,000 SCADA PTS, Redundancy Adder 2,000 SCADA PTS, Redundancy Adder 5,000 SCADA PTS, Redundancy Adder 8,000 SCADA PTS, Redundancy Adder 10,000 SCADA PTS, Redundancy Adder 25,000 SCADA PTS, Redundancy Adder 50,000 SCADA PTS, Redundancy Adder

4.3. Media Kits, Stations and CALs

Model Number	Description
LX-NME120	Experion LX R120 Media Kit, Standard
LX-RME120	Experion LX R120 Media Kit, Redundant
LX-MME120	Experion LX R120 Media Kit, Migration/Demo
LX-STAD01	Experion LX Direct Station
LX-HSTA01	Experion LX Flex Station
LX-SMWIN1	Multi-window Support for Flex Station
LX-PZE000	Station Pan and Zoom
MZ-SQLCL4	Microsoft SQL Runtime CAL
EP-S08CAL	Windows Server 5 Device CAL

EP-T08CAL	Windows Server 2008 Terminal Services CAL
Note – The Experion LX Media Kit includes all of the associated media for the Experion LX software and additional software options..	

4.4. Distributed System Architecture

Model Number	Description
LX-XRESR1	DSA Subscribe (DSA Server Enabler)
Note 1 – Each Experion LX Server is enabled to publish data in a DSA design. CV-XRESR1 is required once for an Server or redundant Server pair that needs to subscribe to data. One DSA Subscribe license is required to subscribe to up to the maximum number of 14 Servers.	

4.5. OPC

Model Number	Description
LX-OPCINT	OPC Integrator
LX-OPCDA1	OPC Data Access Server
LX-OPCHDA	Experion LX OPC Historical Data Access Server
LX-OPCSAE	OPC Alarm & Event Server
LX-OPCADV	OPC Advanced Client

4.6. Experion LX Software Options

Model Number	Description
LX-SMCS30	C300 Simulation Environment
LX-XLDE01	Microsoft Excel Data Exchange
LX-AESHED	Experion LX Point Control Scheduler
LX-SVALGP	ALARM Shelving
LX-SVALDS	Alarm DSA Report
LX-SVPWFB	Power Function Blocks
LX-IDNPHB	DNP3 History Backfill
LX-I61850	IEC61850 Interface
LX-AEPAGE	Alarm Pager
LX-DASENB	Dynamic Alarm Suppression
LX-ALMTND	Alarm Tracker
LX-ADSP01	Advanced HMIWeb Solution Pack
LX-IHWMLS	Experion LX Masterlogic Integration
LX-IADDVM	Experion LX DVM Integration
LX-IEMB00	Enron Modbus Interface
LX-IEMBOE	Enron Modbus EFM Functionality

4.7. Engineering Tools

Model Number	Description
LX-COBLDR	Control Builder
LX-QKBLDR	Quick Builder – SCADA database builder
LX-DSBLDR	Display Builder 1
LX-BKCF00	Enhanced Bulk Configuration Tools for Control Builder

LX-AEAPD1	Application Development Toolkit
LX-CADL02	CAB Developer
Note 1 – Includes HMIWeb Display Builder and Display Builder. Control Builder, Quick Builder and Display Builder - one copy of each is included with the base software	

4.8. Batch Manager

Model Number	Description
LX-CBR010	Class Based Recipe Running 10 Instances
LX-CBR025	Class Based Recipe Running 25 Instances
LX-CBR100	Class Based Recipe Running 100 Instances
LX-CBR300	Class Based Recipe Running 300 Instances

4.9. Field Device Usage

Model Number	Description
LX-FFLX01	Fieldbus Usage License, 1 FIM
LX-FFLX05	Fieldbus Usage License, 5 FIM
LX-EPLX01	Ethernet/IP License

4.10. Qualification and Version Control System

Model Number	Description
LX-QVC0BS	Qualification and Version Control System Base Software
LX-QVC100	100 Point QVCS
LX-QVC01K	1000 Point QVCS
LX-QVC02K	2000 Point QVCS
LX-QVC05K	5000 Point QVCS
LX-QVC10K	10000 Point QVCS
QVCS support licensing is directly related to the Server Process Point count. The user must choose a base option first, and then the appropriate option identical to the Process Point count.	

4.11. Electronic Signature

Model Number	Description
LX-ESIG01	Electronic Signature Option
Provides the necessary functions, such as Electronic Signature support, for regulated industries. The Experion Server provides enhanced capabilities to support the Pharmaceutical industry and other FDA regulated industries and their unique requirements related to regulations such as 21 CFR Part 11. These features may be employed in any industry but are specifically designed to meet the guidelines of 21 CFR Part 11	

5. Glossary

Term or Acronym	Description
C300	A specific type of Honeywell Process Controller based on the series C form factor
CDA	Control Data Access is the Experion LX system communication infrastructure and data access interface schema that provides application integration with Experion LX system objects.
DCS	Distributed Control System
DSA	Distributed System Architecture
Experion LX Server	The node (optionally redundant) at the heart of Experion LX. The Server encompasses a wide range of subsystems including history collection, SCADA interfaces, alarm/event, etc.
FTE	Fault Tolerant Ethernet, the Experion LX control network
HMI	Human machine interface
HMIWeb	Human machine interface based on Web Technology
HTML	Hypertext Markup Language
MasterLogic	Honeywell PLC for fast logic applications supporting IEC programming languages
OPC	Series of standard specification for open connectivity in industrial automation originally based on Microsoft's OLE COM and DCOM technologies.
pps	Parameters per second
RTU	Remote Terminal Unit
SCADA	Supervisory Control and Data Acquisition
Safety Manager (SM)	Honeywell's SIL3 Safety System
Uniformance PHD	Flexible environment for the collection, storage and analysis of process data. A Process History Database (PHD) database may be centrally configured and managed, gathering data from many systems including Honeywell Experion LX, Experion PKS and TotalPlant Solution (TPS), OPC Servers, and other third-party sources.

Experion™ and Experion LX™ are trademarks of Honeywell International Inc..

All other products and brand names shown are trademarks of their respective owners.

This document contains Honeywell proprietary information. It is published for the sole usage of Honeywell Process Solutions' customers and prospective customers worldwide. Information contained herein is to be used solely for the purpose submitted, and no part of this document or its contents shall be reproduced, published, or disclosed to a third party without the express permission of Honeywell International Inc..

While this information is presented in good faith and believed to be accurate, Honeywell disclaims the implied warranties of merchantability and fitness for a particular purpose and makes no express warranties except as may be stated in its written agreement with and for its customer.

In no event is Honeywell liable to anyone for any indirect, special or consequential damages. The information and specifications in this document are subject to change without notice.

Sales and Service

For application assistance, current specifications, pricing, or name of the nearest Authorized Distributor, contact one of the offices below.

ASIA PACIFIC

Honeywell Process Solutions,
(TAC) hfs-tac-support@honeywell.com

Australia

Honeywell Limited
Phone: +(61) 7-3846 1255
FAX: +(61) 7-3840 6481
Toll Free 1300-36-39-36
Toll Free Fax:
1300-36-04-70

China – PRC - Shanghai

Honeywell China Inc.
Phone: (86-21) 5257-4568
Fax: (86-21) 6237-2826

Singapore

Honeywell Pte Ltd.
Phone: +(65) 6580 3278
Fax: +(65) 6445-3033

South Korea

Honeywell Korea Co Ltd
Phone: +(822) 799 6114
Fax: +(822) 792 9015

EMEA

Honeywell Process Solutions,
Phone: + 80012026455 or
+44 (0)1344 656000

Email: (Sales)

FP-Sales-Apps@Honeywell.com

or

(TAC)

hfs-tac-support@honeywell.com

AMERICA'S

Honeywell Process Solutions,
Phone: (TAC) 1-800-423-9883 or
215/641-3610
(Sales) 1-800-343-0228

Email: (Sales)

FP-Sales-Apps@Honeywell.com

or

(TAC)

hfs-tac-support@honeywell.com

Specifications are subject to change without notice.

For more information

To learn more about Experion,
visit www.honeywellprocess.com
Or contact your Honeywell Account Manager

Process Solutions

Honeywell
1250 W Sam Houston Pkwy S
Houston, TX 77042

Honeywell Control Systems Ltd
Honeywell House, Skimped Hill Lane
Bracknell, England, RG12 1EB

Shanghai City Centre, 100 Jungi Road
Shanghai, China 20061

www.honeywellprocess.com

Distributed by:



888.858.3745 | relevantsolutions.com

Honeywell

LX03-200-120, Ver.1.1

August 2015

©2015 Honeywell International Inc.